



# INSTALLATION AND MAINTENANCE INSTRUCTIONS

## MODEL MLCK FLEXIBLE CONNECTOR



THIS SYMBOL ON THE NAMEPLATE MEANS THE PRODUCT IS LISTED BY UNDERWRITERS LABORATORIES. LISTING NO. MH 17528 (FOR CHIMNEY LINERS) LISTING NO. MH 25730 (FOR VENT CONNECTORS)

### CAUTION:

Metal-Fab flexible connector has been designed to properly connect Category I gas-burning appliances to listed chimney-lining systems or listed Type-B gas vent. Category I appliances operate with a non-positive vent static pressure and with a vent temperature that avoids excessive condensate production in the vent. Appliances burning solid or liquid fuels, or category II, III, or IV furnaces, are not to be connected to this flex connector.

Metal-Fab product may be installed in an unenclosed space between the appliance and the listed masonry chimney system or Type-B gas vent. This flexible connector must not pass through any combustible structure such as a wall, ceiling, floor, attic space, or crawl space. Contact local building or fire officials about restrictions and installations in your area.

The flexible connector must not be sized less than that specified in the appliance manufacturers instructions.

Clearances for Metal-Fab flexible connector to unprotected combustible material is 1" in open air space and must be in accordance with "**Minimum Appliance Clearance**" specified in NFPA 211.

To properly size the connector, follow the Category I venting table now contained in the National Fuel Gas Code (NFPA 54/ANSI Z223.1).

While installing flex liner, consideration should be given to the following:


1. Make no unnecessary bends
2. Make no bends greater than 90 degrees
3. Make bends as smooth as possible, with no dips or snags, and
4. Install with at least a 1/4" per foot rise

### INSTALLATION:


1. Determine the length of the connector needed to connect an appliance to:
  - a. Inlet of listed chimney lining system, or
  - b. Inlet of Type-B gas vent Tee or "Y" that is connecting multiple appliances.

Metal-Fab's flexible connector will span a distance of up to 5 ft. If it is necessary to shorten the overall length of the connector, cut off excess flex from the inlet (bottom) end being careful to re-attach the inlet sleeve to the shortened length of flex.


2. To configure the flexible connector to its proper length, pull and stretch to the required length being careful not to over-stretch the connector.
3. Twist lock the outlet (top end of the connector to):
  - a. The inlet of the chimney lining system, (See **FIG. 1**)
  - b. Inlet of the Type-B gas vent system (See **FIG. 2**), or
  - c. Inlet end of Type-B gas vent Tee or "Y" (See **FIG. 3**)

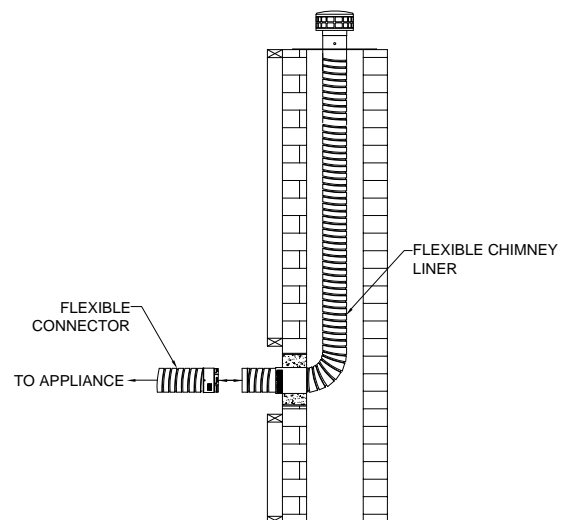

**FIG. 1**

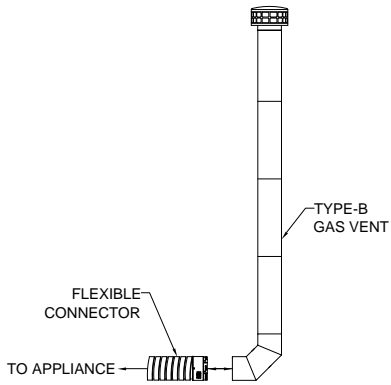


**FIG. 2**

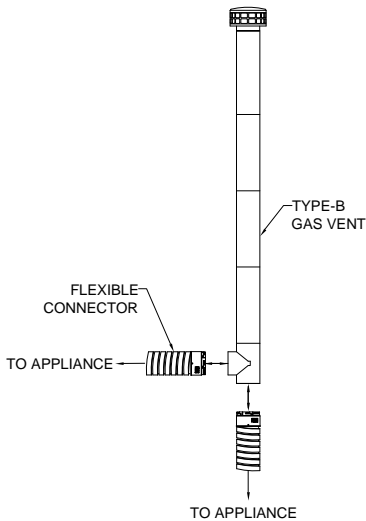


**FIG. 3**

4. Form the flexible connector(s) into the configuration that enables connection to:
  - a. A single appliance (See **FIG. 4**) or
  - b. Multiple appliances (See **FIG. 5**).
 Be careful not to make any abrupt or sharp bends or create bends greater than 90 degrees.

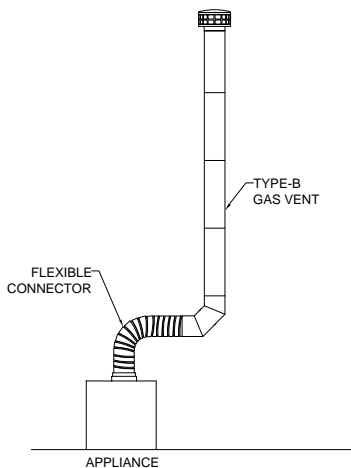


**FIG. 4**

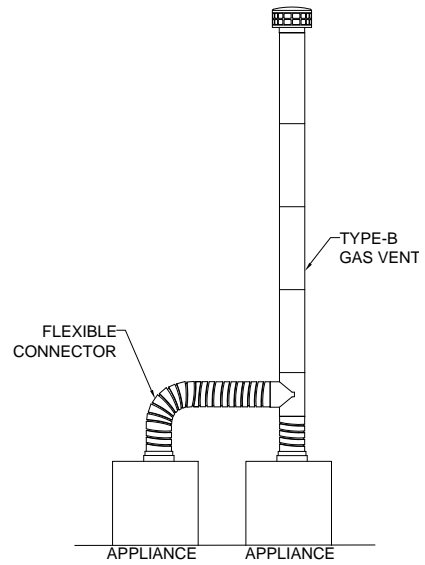

**FIG. 5**

5. Attach the inlet (bottom) end of the connector to the appliance or to any applicable B-Vent style appliance outlet fitting (See **FIG. 6**). Use sheet metal screws, as necessary to securely fasten the connector inlet fitting to the appliance or appliance outlet fitting

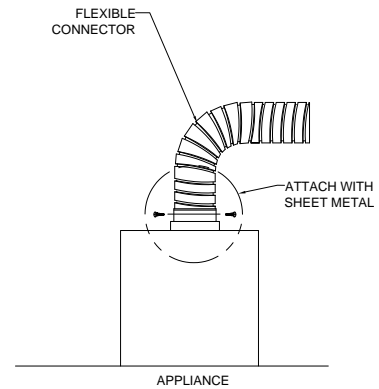

**FIG. 6**

6. After making all connections, check the system for soundness of connections and compliance with clearance to combustibles.

**MAINTENANCE INSTRUCTIONS:**

A qualified person should check the chimney lining system at least once per year following initial installation, to insure connections are tight and the flexible connector has not sagged.



P.O Box 1138 • Wichita, KS 67201  
 (316) 943-2351 • FAX (316) 943-2717